



DC17V-DC33V Addressable Manual Call Point For Intelligent Fire Safety Alarm System

Our Product Introduction

Basic Information

- Place of Origin: China
- Brand Name: XHA
- Certification: CE
- Model Number: CA9006
- Minimum Order Quantity: 1PCS
- Price: negotiable
- Packaging Details: 100pcs/carton
- Delivery Time: 3 Working days
- Payment Terms: T/T, Western Union
- Supply Ability: 100000PCS/Month



Product Specification

- Types Of Smoke Detectors: Addressable Manual Call Point Button
- Working Voltage: DC17V-DC33V
- Wire Type: Non-Polarity 2-Wired
- Installation: Wall Mounted
- Connected: Loop Bus
- Customized: Acceptable
- Highlight: DC17V Addressable Manual Call Point, DC33V Addressable Manual Call Point



for more products please visit us on xhafiresafety.com

Product Description

Addressable Manual Call Point For Intelligent Fire Safety Alarm System



Introduction

CA9006 manual call point adopts the latest digital loop protocol, electronic coding mode, including telephone jack. Installed in public places such as the wall of the building walkway, hotel floor near the service desk and other eye-catching places. After confirming the fire, press the operation board to send a fire alarm signal to the controller, and use the special key to reset the alarm state reported by the hand.


Parameters

Product name	Manual Call Point (MCP)	Type	Addressable
Loop Bus wired	2-wire Non-polarized	Monitor Current	$\leq 300\mu\text{A}$
Alarm Current	$\leq 2\text{mA}$	Dimension	$\Phi 85 \times 42 \text{ mm}$
Work voltage	DC17V DC33V	Operating Environment	Temperature $-10^{\circ}\text{C} \sim +50^{\circ}\text{C}$ Humidity $\leq 95\%$.
Weight	Weight: 95g(with base)	Certification	CE


Main Functions

- Electrically addressed, can be modified by programmer.
- Re-settable (non-breaking glass) via special key
- Communication: 2 wires, Non-polarized.

Connection between MCP

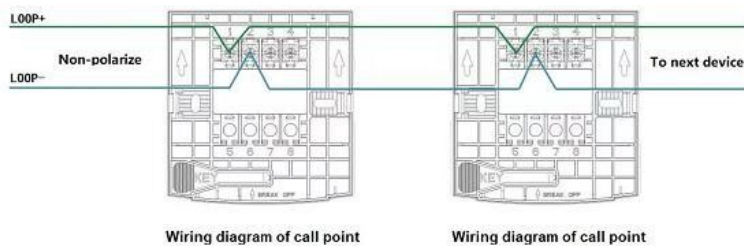

Connection Diagram of Fire Alarm System

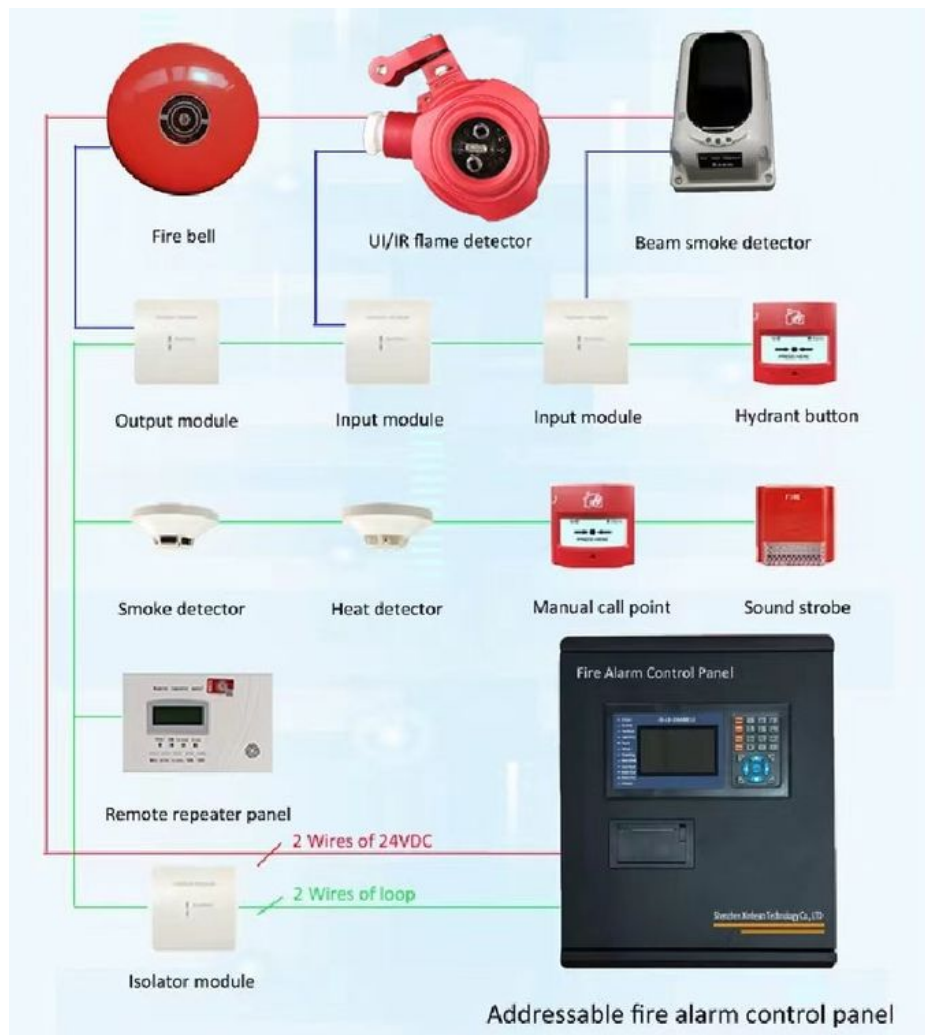

Product range

Conventional Fire Alarm System
 Addressable fire alarm system
 Gas Extinguishing control system
 Beam Detector
 4 wire smoke detectors with relay output.
 2 wire Conventional smoke and heat detectors
 Explosion-proof flame detector for fire alarm system
 Standalone smoke detectors and combustible gas detector

Service

1. OEM & ODM service.
2. Provide technical support and after-sale service.
3. 1 year warranty.

4. Normally 15 working days lead time.
5. Welcome sample order.



Shenzhen Xinhe'an Technology Co., Ltd.



+8615986702194



Claire.tian@xinheantech.com



xhafiresafety.com

406,Jude Building,Zhengfeng South Road,Fuyong Street,Bao'An District, Shenzhen City, Guangdong Province.
China,518103